


- NOTES:
- FOOTING CONCRETE SHALL BE A MINIMUM 2000 PSI AT 28 DAYS.
 - THE FOLLOWING ITEMS SHALL BE REQUIRED ON ALL INSTALLATIONS:
 - TOP HORIZONTAL RAIL (1 1/2")
 - 9 GA. WIRE FASTENERS SHALL BE USED.
 - 9 GA. WIRE TO BE USED AROUND HIGH DANGER ENCLOSURES SUBJECT TO CITY ENGINEER DISCRETION; (OTHER AREAS 11 GA. ACCEPTABLE)
 - ALL PIPE SHALL BE GALV. SCHD. 40

FENCE

DIAMETER OF FOOTING = 4 TIMES
OUTSIDE DIAMETER OF POST.

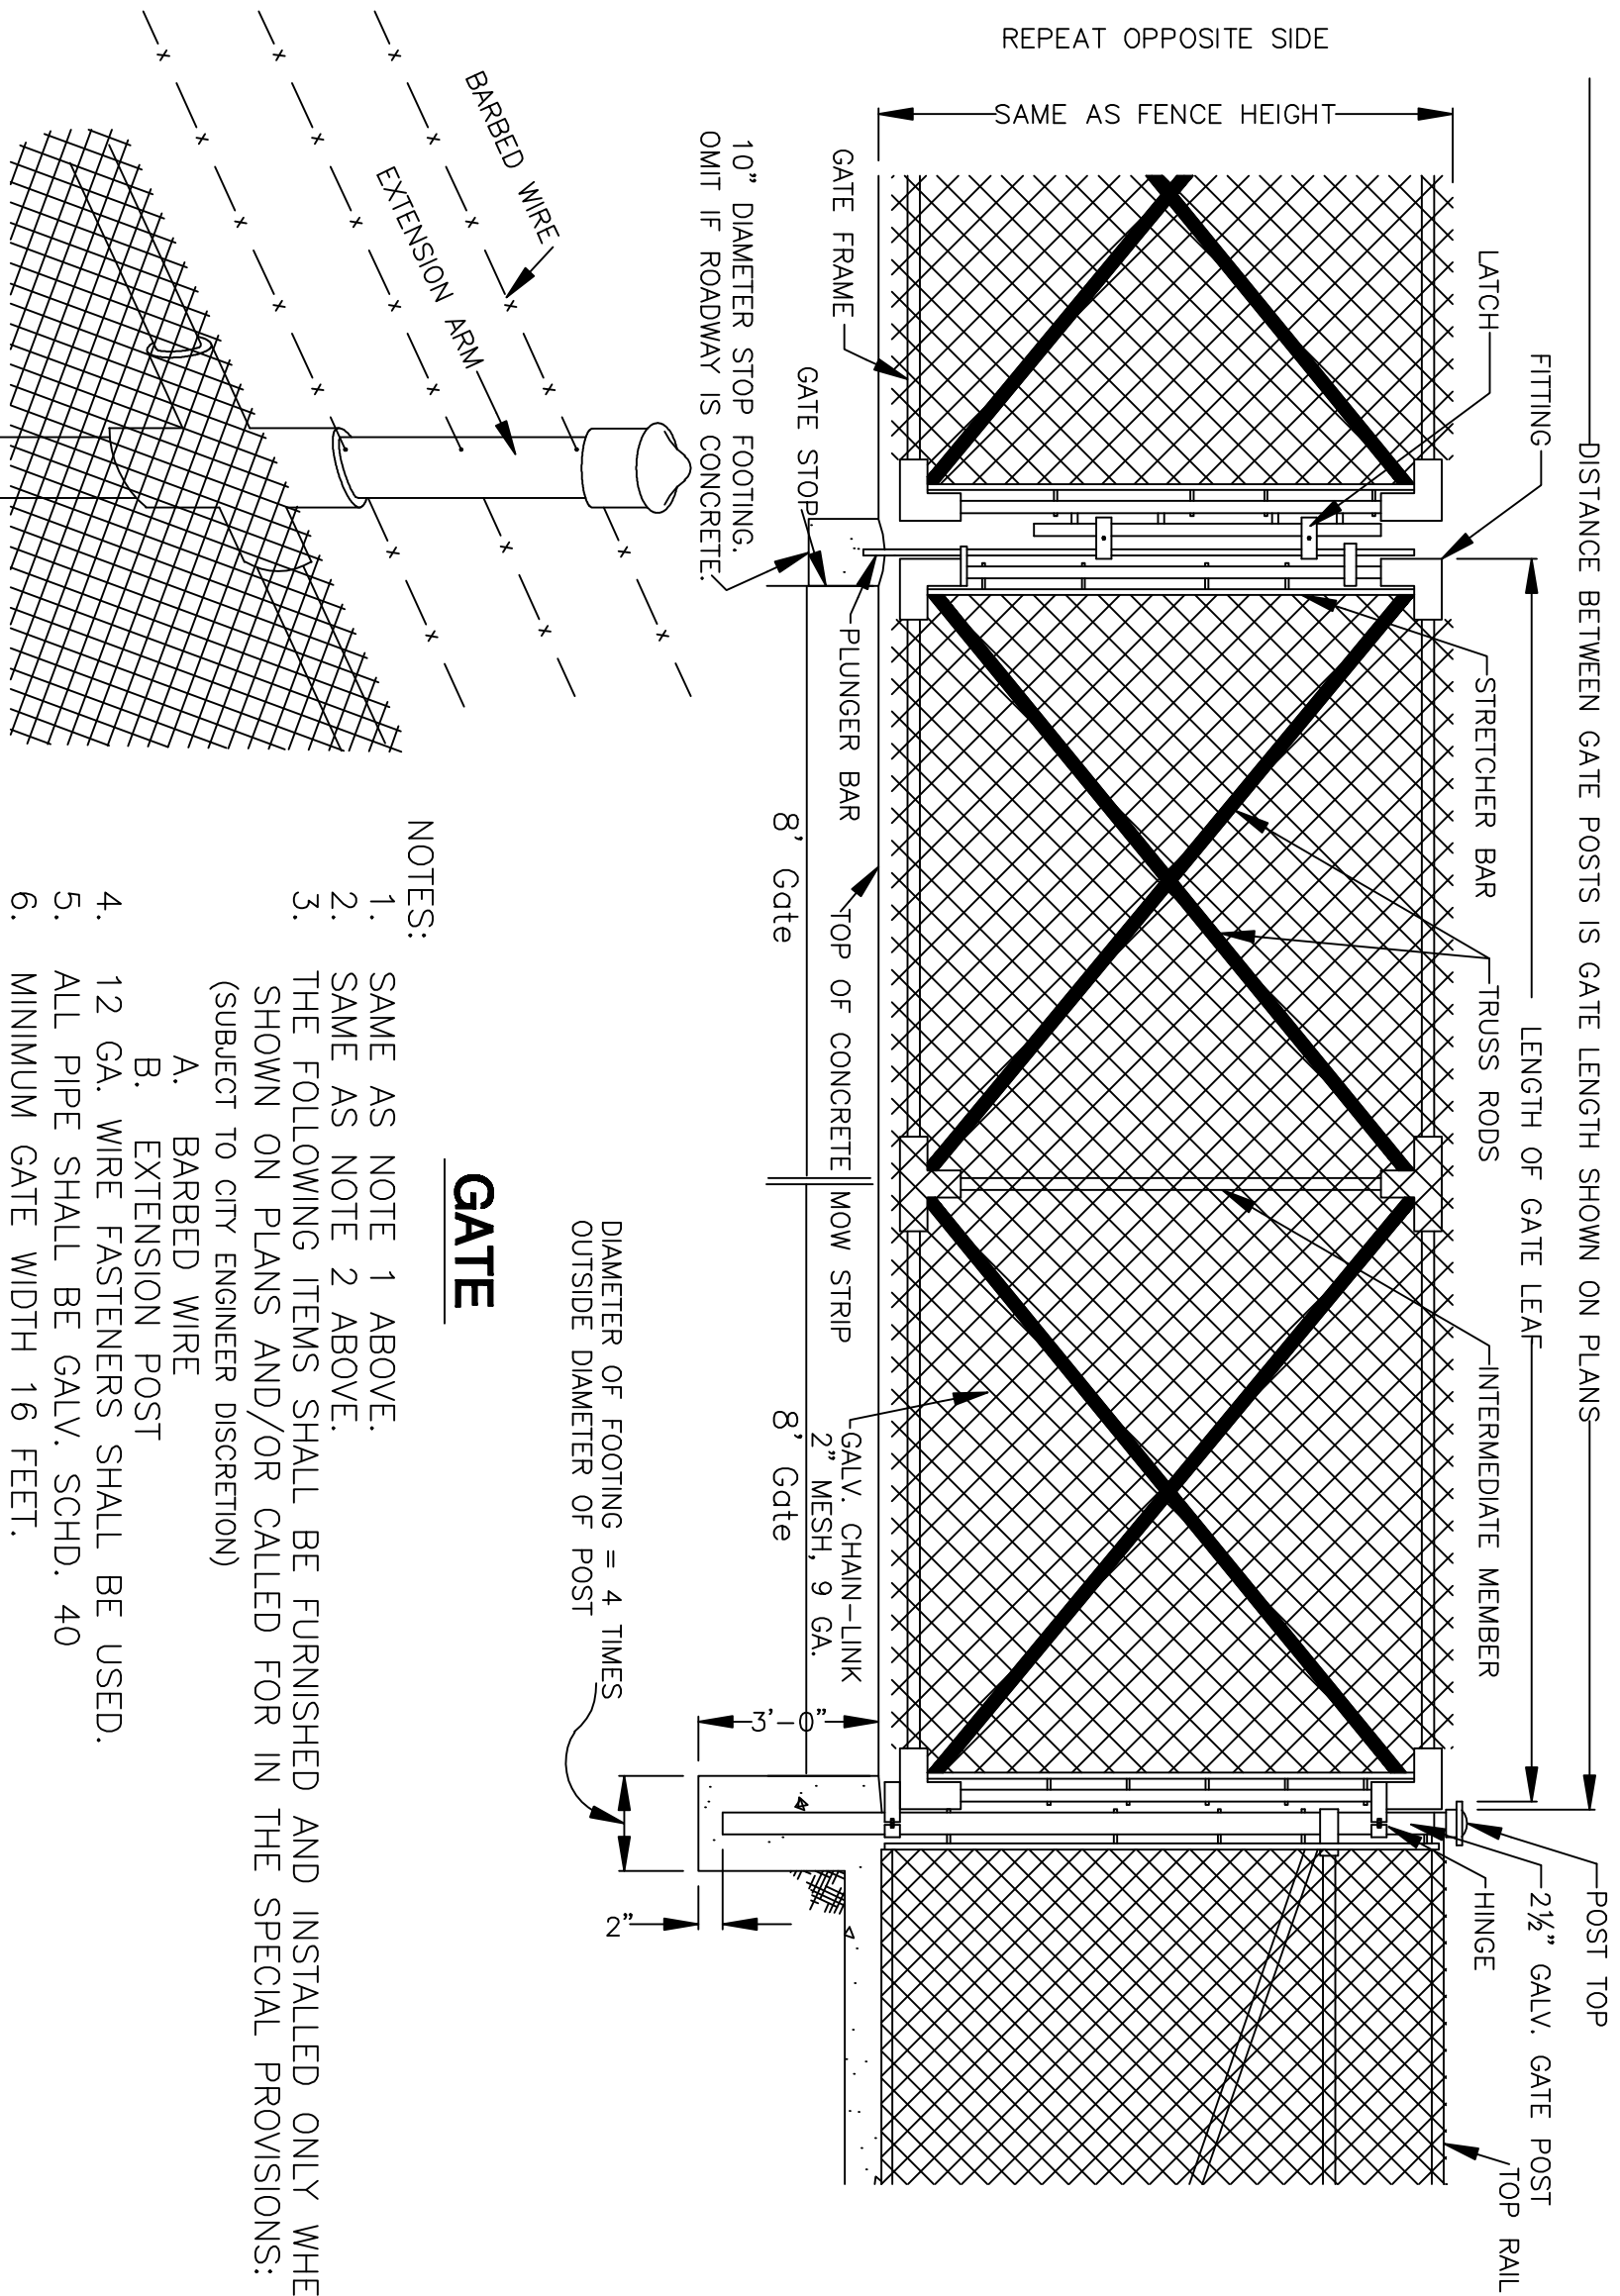

- NOTES:
- SAME AS NOTE 1 ABOVE.
 - SAME AS NOTE 2 ABOVE.
 - THE FOLLOWING ITEMS SHALL BE FURNISHED AND INSTALLED ONLY WHEN SHOWN ON PLANS AND/OR CALLED FOR IN THE SPECIAL PROVISIONS: (SUBJECT TO CITY ENGINEER DISCRETION)
 - BARBED WIRE
 - EXTENSION POST
 - 12 GA. WIRE FASTENERS SHALL BE USED.
 - ALL PIPE SHALL BE GALV. SCHD. 40
 - MINIMUM GATE WIDTH 16 FEET.

GATE

DIAMETER OF FOOTING = 4 TIMES
OUTSIDE DIAMETER OF POST

CHAIN-LINK FENCE DETAILS

REF. & REV.
MARCH 2005
AUG 2008

CITY OF MADERA

B-3