


## PLAN

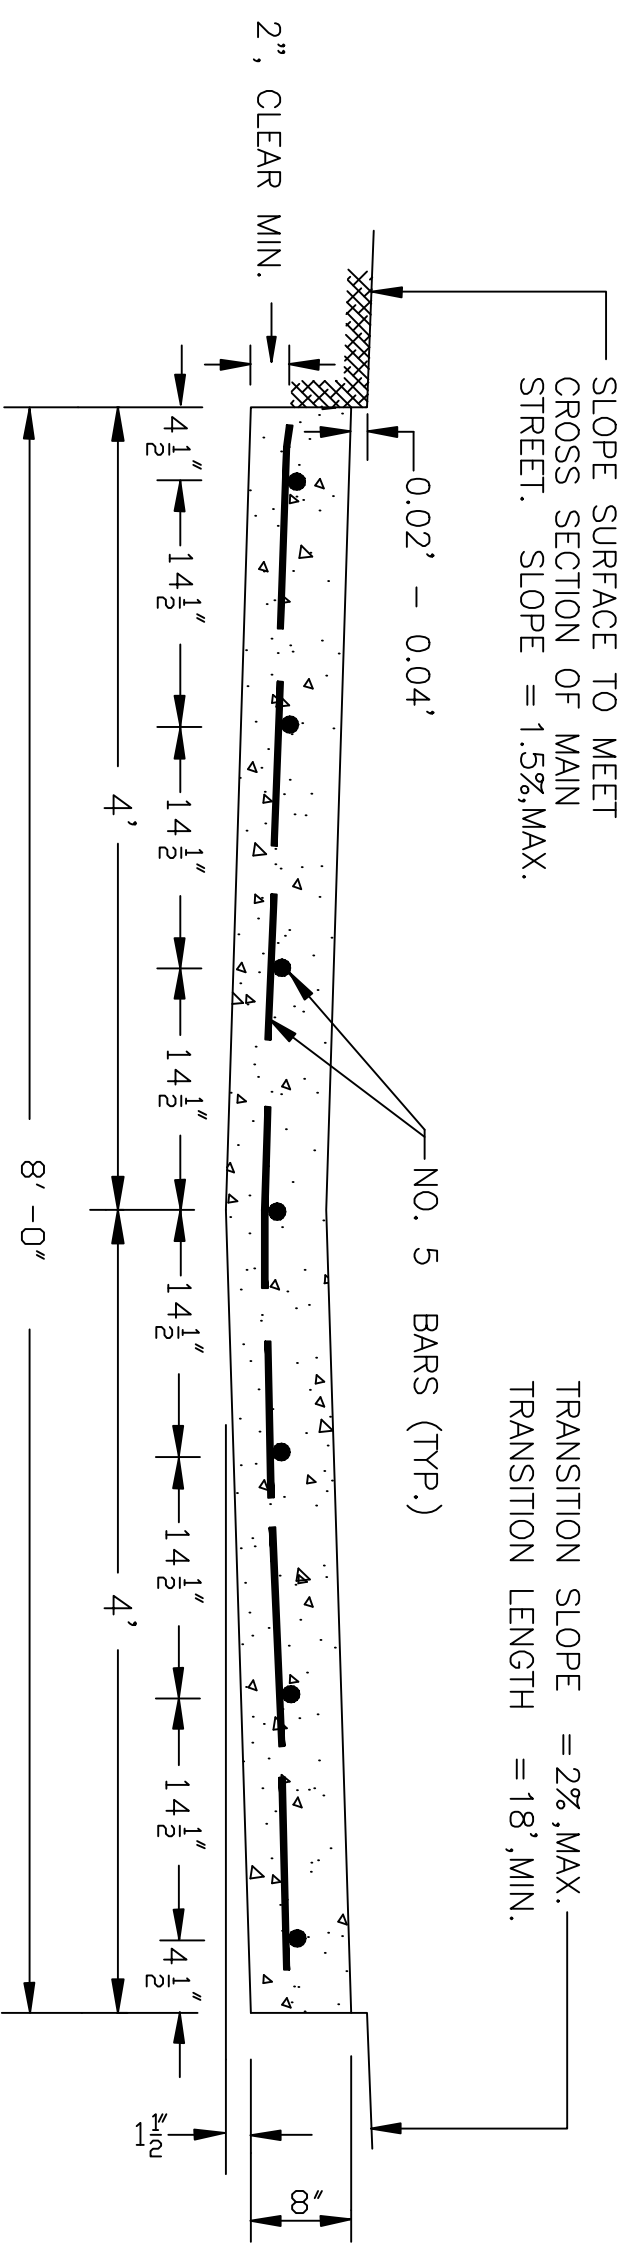

- NOTE:
- 1) IN NEW CONSTRUCTION AREAS, VALLEY GUTTERS SHALL BE DESIGNED TO PROVIDE A MINIMUM DIFFERENCE OF THIRTY-FIVE HUNDREDTHS OF A FOOT (.35') FROM END OF RETURN TO END OF RETURN.
  - 2) ALL VALLEY GUTTERS SHALL BE CONSTRUCTED USING 6 SACK CLASS A CONCRETE PER STD. SPECIFICATIONS 14-2

## SECTION OF GUTTER

CONCRETE VALLEY GUTTER

REF. & REV.  
MARCH 2005  
MAY 2007

CITY OF MADERA

ST-1