


STREET CROSS SECTION (A-A)

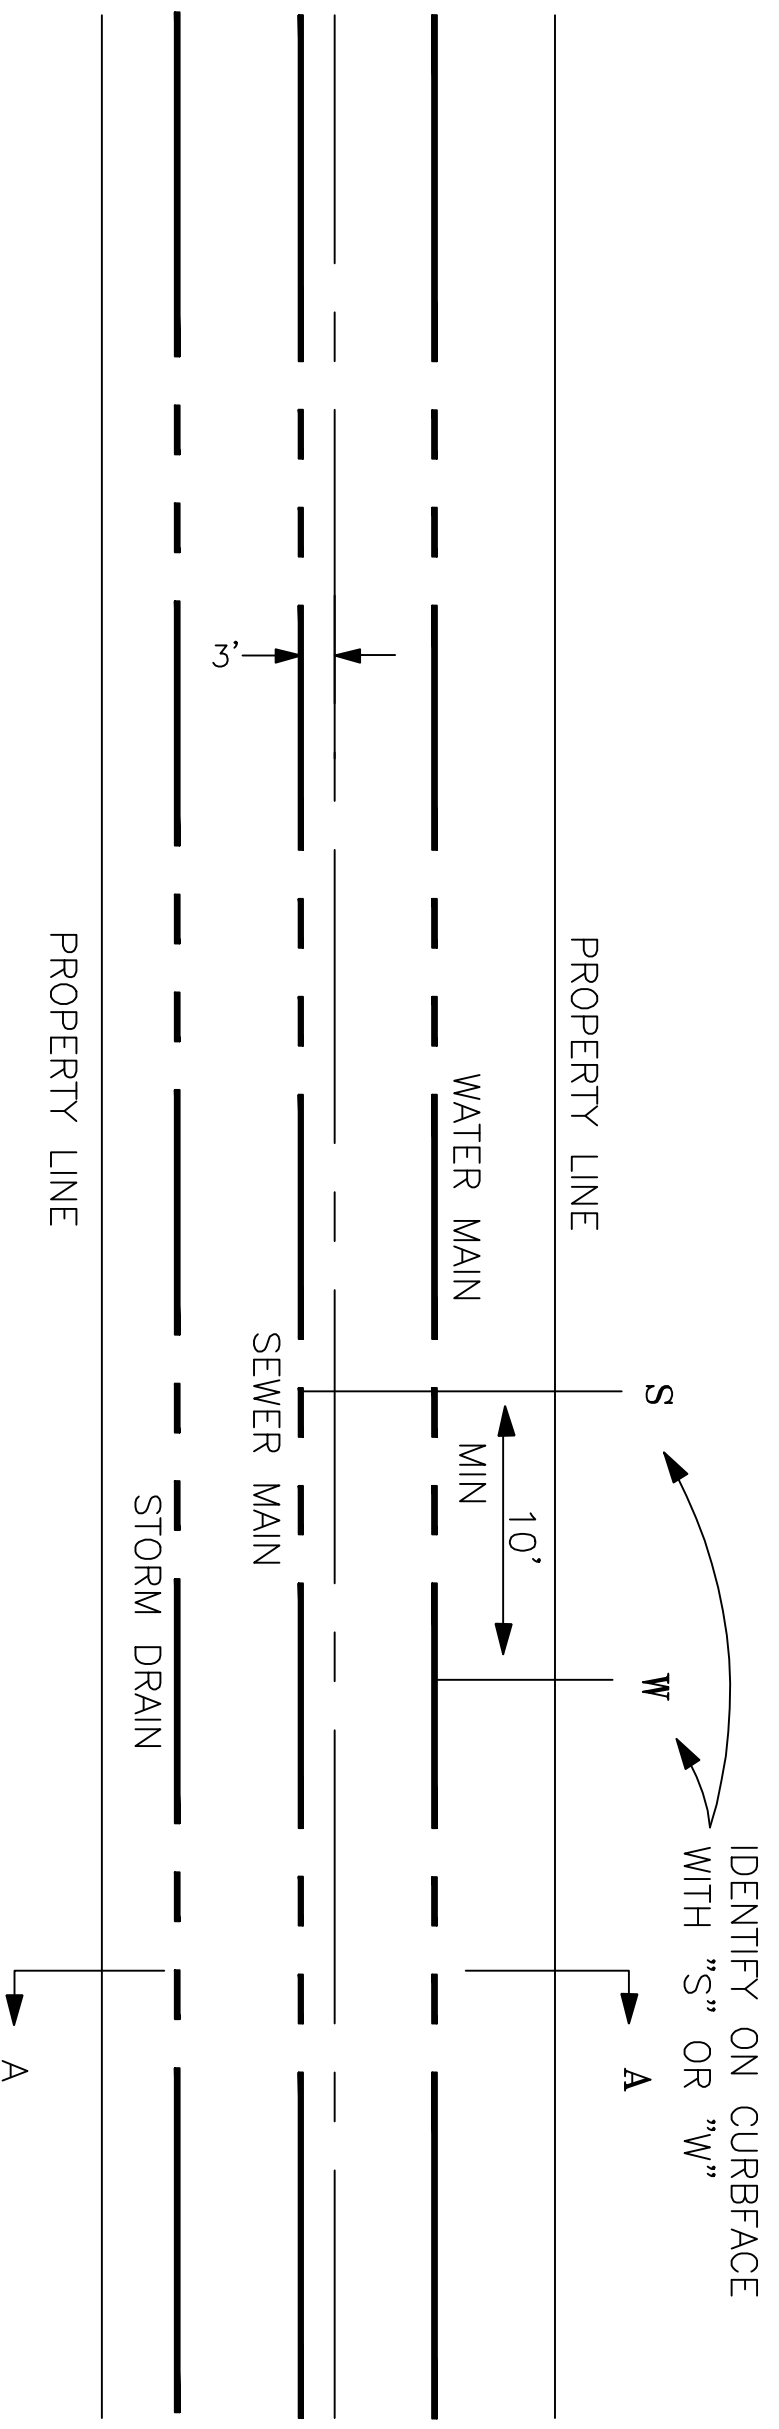

PLAN VIEW

NOTES:

1. Storm drains shall be placed on the same side of the street with the sewer mains.
2. Water mains shall not be placed on the same side of the street with sewer mains.
3. Sewer mains shall be placed three (3) feet South or East of the center line of the street.
4. All underlying sewer pipe and sewer services shall be high pressure pipe where the watermain above is 4" dia. or larger and the clearance is 12" or less.
5. Min. clearance between water and sanitary sewer mains shall be 10' feet.