


IN LIEU OF POURING A THRUST BLOCK ON A FIRE HYDRANT RUN, THE CONTRACTOR SHALL HAVE THE OPTION TO INSTALL A MUELLER A423 FIRE HYDRANT WITH AN AQUQGRIP SHOE AND A MUELLER GATE VALVE WITH AN AQUQGRIP X FLANGE END CONNECTION,(A2361-76) AS DETAILED IN THE ATTACHED DRAWING. IF THE HYDRANT RUN IS SUCH THAT IT REQUIRES A PIPE JOINT THEN AN AQUQGRIP RESTRAINED COUPLING SHALL ALSO BE USED (6"=MODEL#AGC0690).

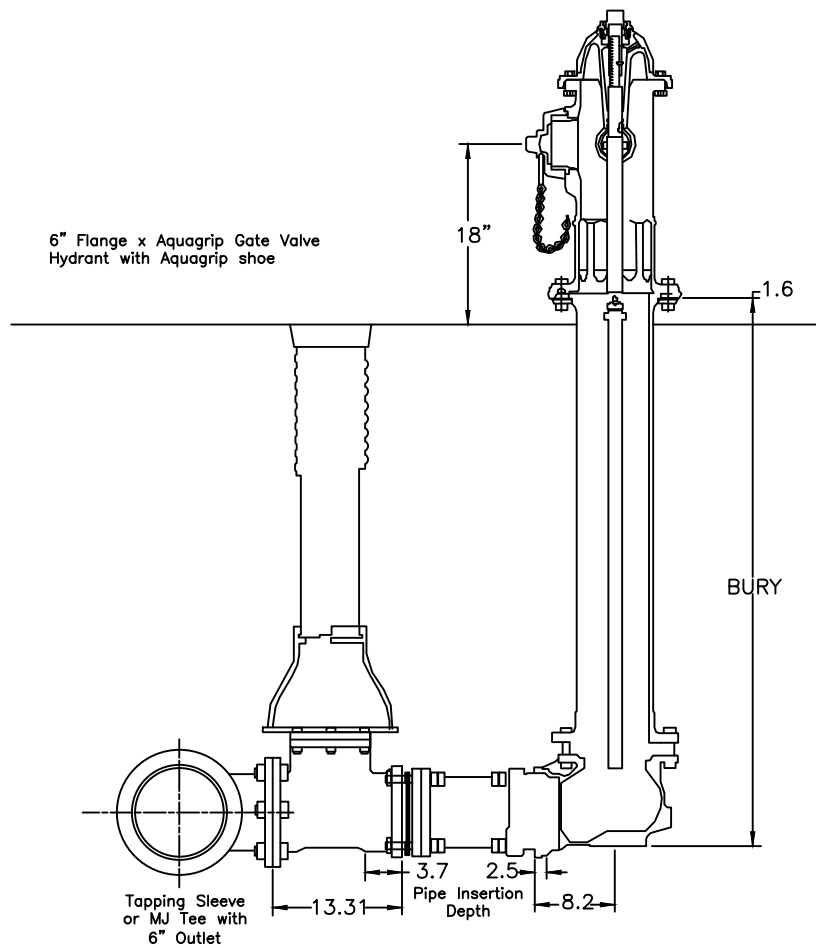

AQUAGRIP GATE VALVE

REF. & REV.
MARCH 2005

CITY OF MADERA

W-29